


CG-MODELS
COOLING COIL

SUPPLY AIR
TO THE ROOM



VENTILATION UNIT DELIVERY



CONDENSATION DRAIN
CONNECTION

MMJ 3x1.5s

MMJ 3x1.5s

GROUPCENTRAL

Nomak 2x2x0.5

ON/OFF CONTROL OF
THE CIRCULATION PUMP
(POTENTIAL FREE
24/0-10VDC
INPUT/CONTROL
CONTACT)

CG-AUTOMATION



P1 FLUID PUMP



P2 CIRCULATION PUMP




SHUT-OFF VALVE



ONE-WAY VALVE




TEMPERATURE DETECTOR



SV50, 3-WAY VALVE
(BELIMO R3...)

TL50, VALVE ACTUATOR
(BELIMO TR24-SR)

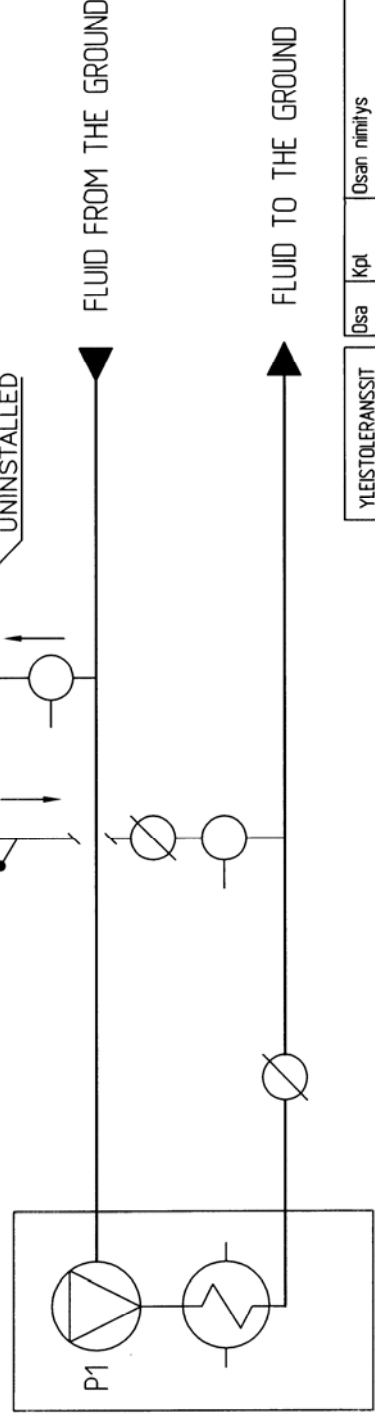

GEOTHERMAL HEAT PUMP

YLEISTOLERANSSIT
Hissatut rakenteet:
EN ISO 13920-AE
Koneistutut osat:
ISO 2768-mk

Osat kpl Osan nimitys
P1irt JR/NEF Tank TOM Hyv
GEOTHERMAL COOLING
PRINCIPLEScheme FOR PUMP GROUP
ENERVENT OY AB
Puh: 010 350 0000
Faksi: 010 350 0001
Internet: E-mail: energiantalvi@enervent.fi

Valmistie
Pvm 22.03.2007
Suhde
Paino kg
P1irt ng AC-CG-PRINCIPLEScheme 3
Muutos
Lehti 1